



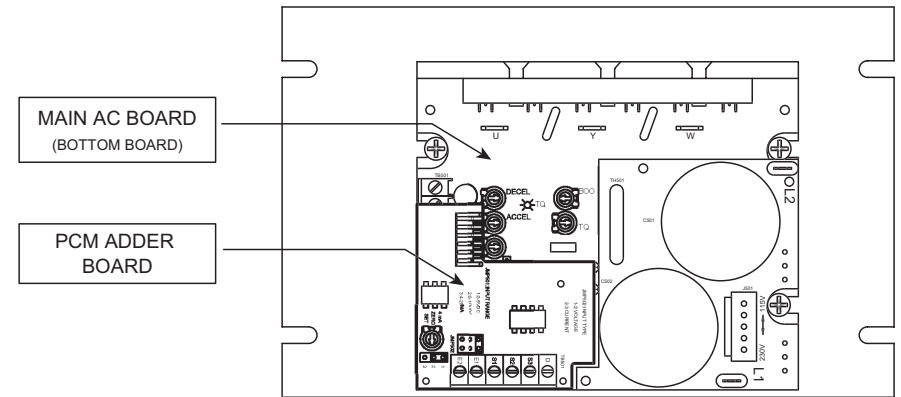


MOUNTING INSTRUCTIONS FOR FHP SERIES PCM ADDER BOARD

The FHP Series PCM Adder Board 175324.00 accepts a 0 - 5 VDC, 0 - 10 VDC, or 4-20 mA signal and outputs an isolated 0-5 VDC signal without requiring additional panel space. It mounts directly over the main AC board (bottom board) thus maintaining the same footprint. This instruction manual will give you step-by-step information for successfully mounting the PCM Adder Board to your FHP Series drive.

The following diagram shows a FHP Series drive with the PCM adder board installed onto the unit and the parts supplied in this kit.

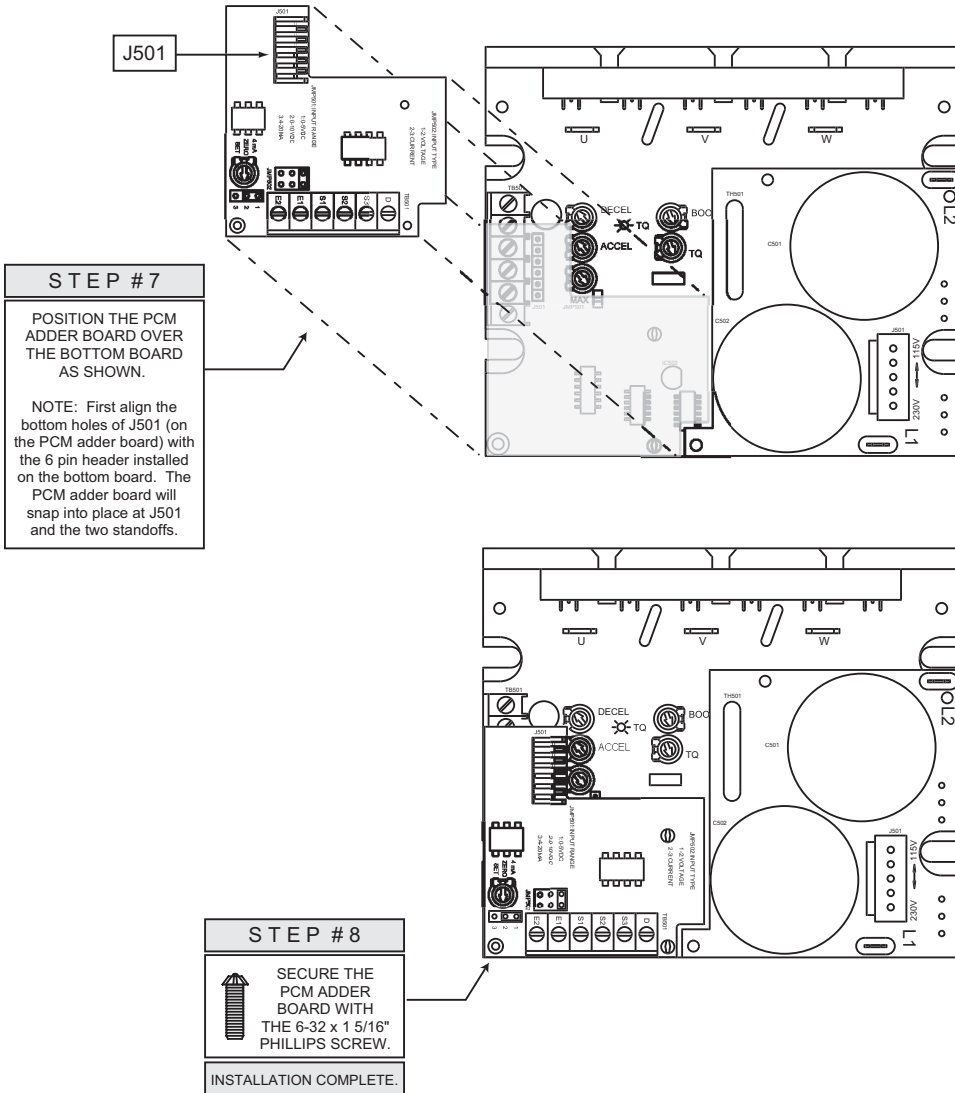

PARTS SUPPLIED IN THIS KIT

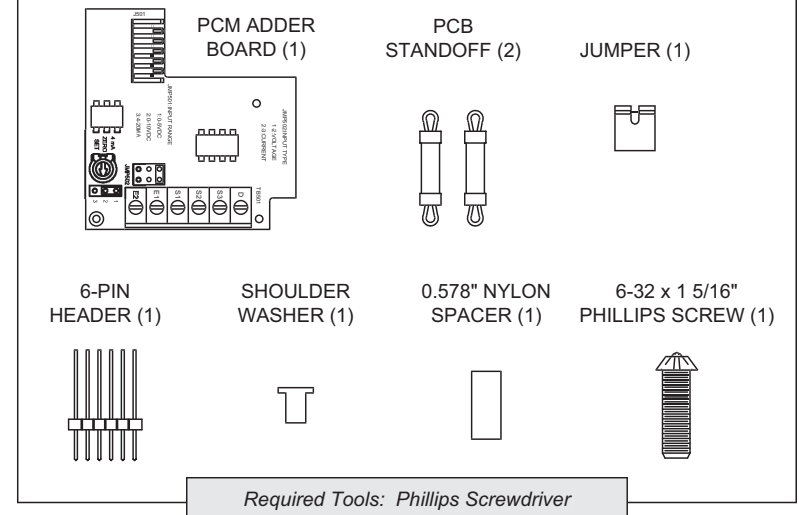

2100 Washington Street
 Grafton, WI 53024-0241, U.S.A.
 TEL: (262) 377-8810 FAX: (262) 377-9025
 Document number 250-0367, Revision 0
 Printed in the U.S.A. - January 2003

